



módulo de extensión piconet para IP-Link 4 entradas analógicas 0(4)...20 mA SNNE-40A-0007

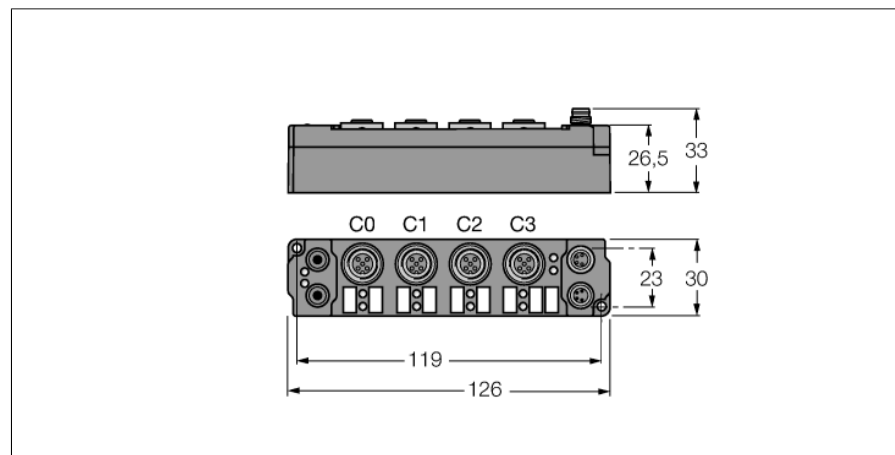


- 4 entradas analógicas 0(4)...20 mA
- conexión directa a IP-Link
- carcasa reforzada por fibra de vidrio
- electrónica de módulos completamente sellada
- conector de metal
- grado de protección IP67


Entrada M12 × 1



Variante de conexión - entradas

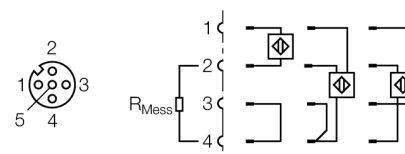

Fuente de alimentación M8 × 1

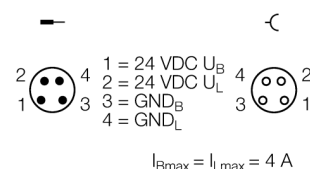

Tipo	SNNE-40A-0007
N.º de ID	6824217
Número de canales	4
Tensión de servicio / de carga	20...29 VDC
Corriente de servicio	≤ 55 mA
Longitud del LWL	≤ 15 m
Número de canales	4 entradas analógicas 20 mA
Resistencia de entrada	80 Ω
Separación de potencial	canales para la tensión de servicio
Tensión de sincronización	máx. 35 V
Corriente de medición	0,5 mA
Tiempo de conversión	250 ms
Error de medición relativo	<±0,3 % de escala completa
Filtro de entrada	variable
Alimentación del sensor	de la tensión de carga
Medidas (An x L x Al)	30 x 126 x 26.5 mm
Control de vibraciones	Conforme a EN 60068-2-6
Control de choques	conforme a EN 60068-2-27
Compatibilidad electromagnética	Conforme a la norma EN 61000-6-2/EN 61000-6-4
Grado de protección	IP67
Aprobaciones	CE, cULus

LEDs

	LED designation	Status green	Status red	Function
IP-Link / module status	RUN / ERR (I/O)	flickers/ON	OFF	Receiving error-free IP-Link protocols
		flickers	flickers	Receiving faulty IP-Link protocols
		OFF	flickers	Receiving faulty IP-Link protocols / system fault
		OFF	ON	No receipt of IP-Link protocols / module error
Inputs	R / E (1...4)	OFF		No data transmission
		ON		Data transmission to D/A converter
			OFF	Error-free data transmission
			ON	Wire break, measured value out of measuring range, etc.
Power supply	U _B	OFF		Operating voltage U _B < 18 VDC
		ON		Operating voltage U _B ≥ 18 VDC
	U _L	OFF		Load voltage U _L < 18 VDC
		ON		Load voltage U _L ≥ 18 VDC

datos en la representación del proceso

		Address	Input data		Output data	
		Word	High-Byte	Low-Byte	High-Byte	Low-Byte
Valid for the setting "Motorola format"		Pre-conditions Compact mapping: Starting with Ch0 D1 in "Low-Byte" word 0 all other bytes follow immediately. Only the user data are mapped (greyed in the table). Complex mapping: Data are mapped with control and status byte.	0	Ch0 D1	SB0	Ch0 D1 CB0
SBn: Status byte channel n	1		SB1	Ch0 D0	CB1	Ch0 D0
CBn: Control byte channel n	2		Ch1 D0	Ch1 D1	Ch1 D0	Ch1 D1
Chn D0: channel n, least significant data byte	3		Ch2 D1	SB2	Ch2 D1	CB2
Chn D1: channel n, most significant data byte	4		SB3	Ch2 D0	CB3	Ch2 D0
	5		Ch3 D0	Ch3 D1	Ch3 D0	Ch3 D1